

# Facility Information

Name: Anchor Hocking, LLC

Shipper:

Department: Plant 42

Site Number: of

State Fees Total: 300.00

Report Year: 2019

## ADDRESS

Street Address:

2893 West Fair Avenue  
Lancaster OH 43130 USA

County: Fairfield Fire District: Lancaster Fire Department Cross Street:

Mailing Address:

1-0

Email:

## PHONES (Type & Phone Number)

24-hour 6145788958

## CONTACTS

Ryder, Robert, Senior Director, Engineering

Phone: Work: 7247733252

Phone: 24-hour: 6145788958

The Oneida Group, , Owner

Phone: Work: (800) 562-7511

Norby, Paul, Director of Distribution

Phone: 24-hour: 7408232521

Phone: Work: 7406816862

Lancaster Fire Department,

Phone: Emergency: 7406876640

## CHEMICAL INVENTORY

Lead/ Acid Batteries

## CHECKLIST

Submitted general site plan of facility to the state and local emergency planners (Sections 301-303 of ERCRA, 40 CFR sections 300 and 355).

SDS received with Tier II forms

All facility info (not including chemical info) is identical to last year's submission

Are dikes or other safeguard measures employed?

Site coordinate abbreviations submitted

Chemicals in Inventory records for facility

EHS Chemicals in Inventory records for facility

Screening & Scenarios records for facility

Incident records for facility

Facility plotted in MARPLOT

Date Tier II Signed: 2/28/2020 Signature: Robert C. Ryder/ Senior Director, Engineering

Feb 26, 2020

## ID CODES

NAICS, 493110, General Warehousing and Storage

Dun & Bradstreet, 797072464,

SIC, 4225, GENERAL WAREHOUSING & STORAGE

## REGULATORY INFORMATION

Subject to Emergency Planning under Section 302 of EPCRA (40 CFR part 355)?

Yes  No

## Facility Information

Subject to Chem. Accident Prevention under Section 112(r) of CAA (40 CFR part 68, Risk Mgmt. Pgm.)?  Yes  No

Is the facility manned?  Manned  Unmanned      Maximum No. of Occupants: 159

### STATE FIELDS

Ohio requests the following:

Initial Filing (First Time Filer): NO

Updated Filing: NO

Annual Filing: YES

Confidential Location Forms Included: NO

Total EHS Chemicals Included (Not Including Below-threshold Chemicals): 1

Number of Chemicals Included (Not Including Below-threshold Chemicals): 1

Facility name has changed since last Tier II filing: NO

Previous facility name (if known):

Owner/Operator has changed since last Tier II filing: NO

Previous parent company/owner (if known):

### INCIDENTS

No Incident data available.

### MAP DATA

Latitude: 39.73441    Longitude: -82.65939

Record is linked to MARPLOT object

### SCREENING & SCENARIOS

No Screening & Scenarios data available.

### LOCATIONS

Location: Battery Charging Area    Chemical: Lead/ Acid Batteries    Amount:

Type: Battery    Pressure: Ambient pressure    Temperature: Ambient temperature

Location: Ubiquitous    Chemical: Lead/ Acid Batteries    Amount:

Type: Battery    Pressure: Ambient pressure    Temperature: Ambient temperature

Location: Pump House    Chemical: Lead/ Acid Batteries    Amount:

Type: Battery    Pressure: Ambient pressure    Temperature: Ambient temperature

### NOTES

No Notes data available.



State Emergency  
Response Commission

Tier 2 Submit  
Calendar Year 2019  
Certification

I hereby certify that I have reviewed the information submitted on the media enclosed and/or email attachment for the facility listed on this certification and that, to the best of my knowledge and belief, the submitted information is true and complete and that the amounts and values in this report are accurate based on the data available to the owners/operator of this facility.

Robert C. Ryder

Senior Director, Engineering

Name

Title

2 / 25 / 2020

Signature

Date Signed

Facility Name Anchor Hocking, LLC-Plant 42

Address 2893 West Fair Avauue

City Lancaster

OH Zip 43130 -

County Fairfield

For multiple facility reports stored within flashdrive or email attachment, please list additional county or counties

---

---

---

---

---

---

---

---

---

---

---


---

---

---



MAP ID	CONTAINER	MATERIAL	CAPACITY
A	300-Gallon Above Ground Storage Tank	Diesel Fuel	300 Gallons
B	250-Gallon Above Ground Pump House Storage Tank	Diesel Fuel	250 Gallons
D	55-Gallon Reservoir	Oil	55 Gallons
E	(5) 55-Gallon Drums	Oil	275 Gallons
F	3 Transformers	Transformer Silicone Oil	719 Gallons
G	2 Transformers	Transformer Oil	500 Gallons

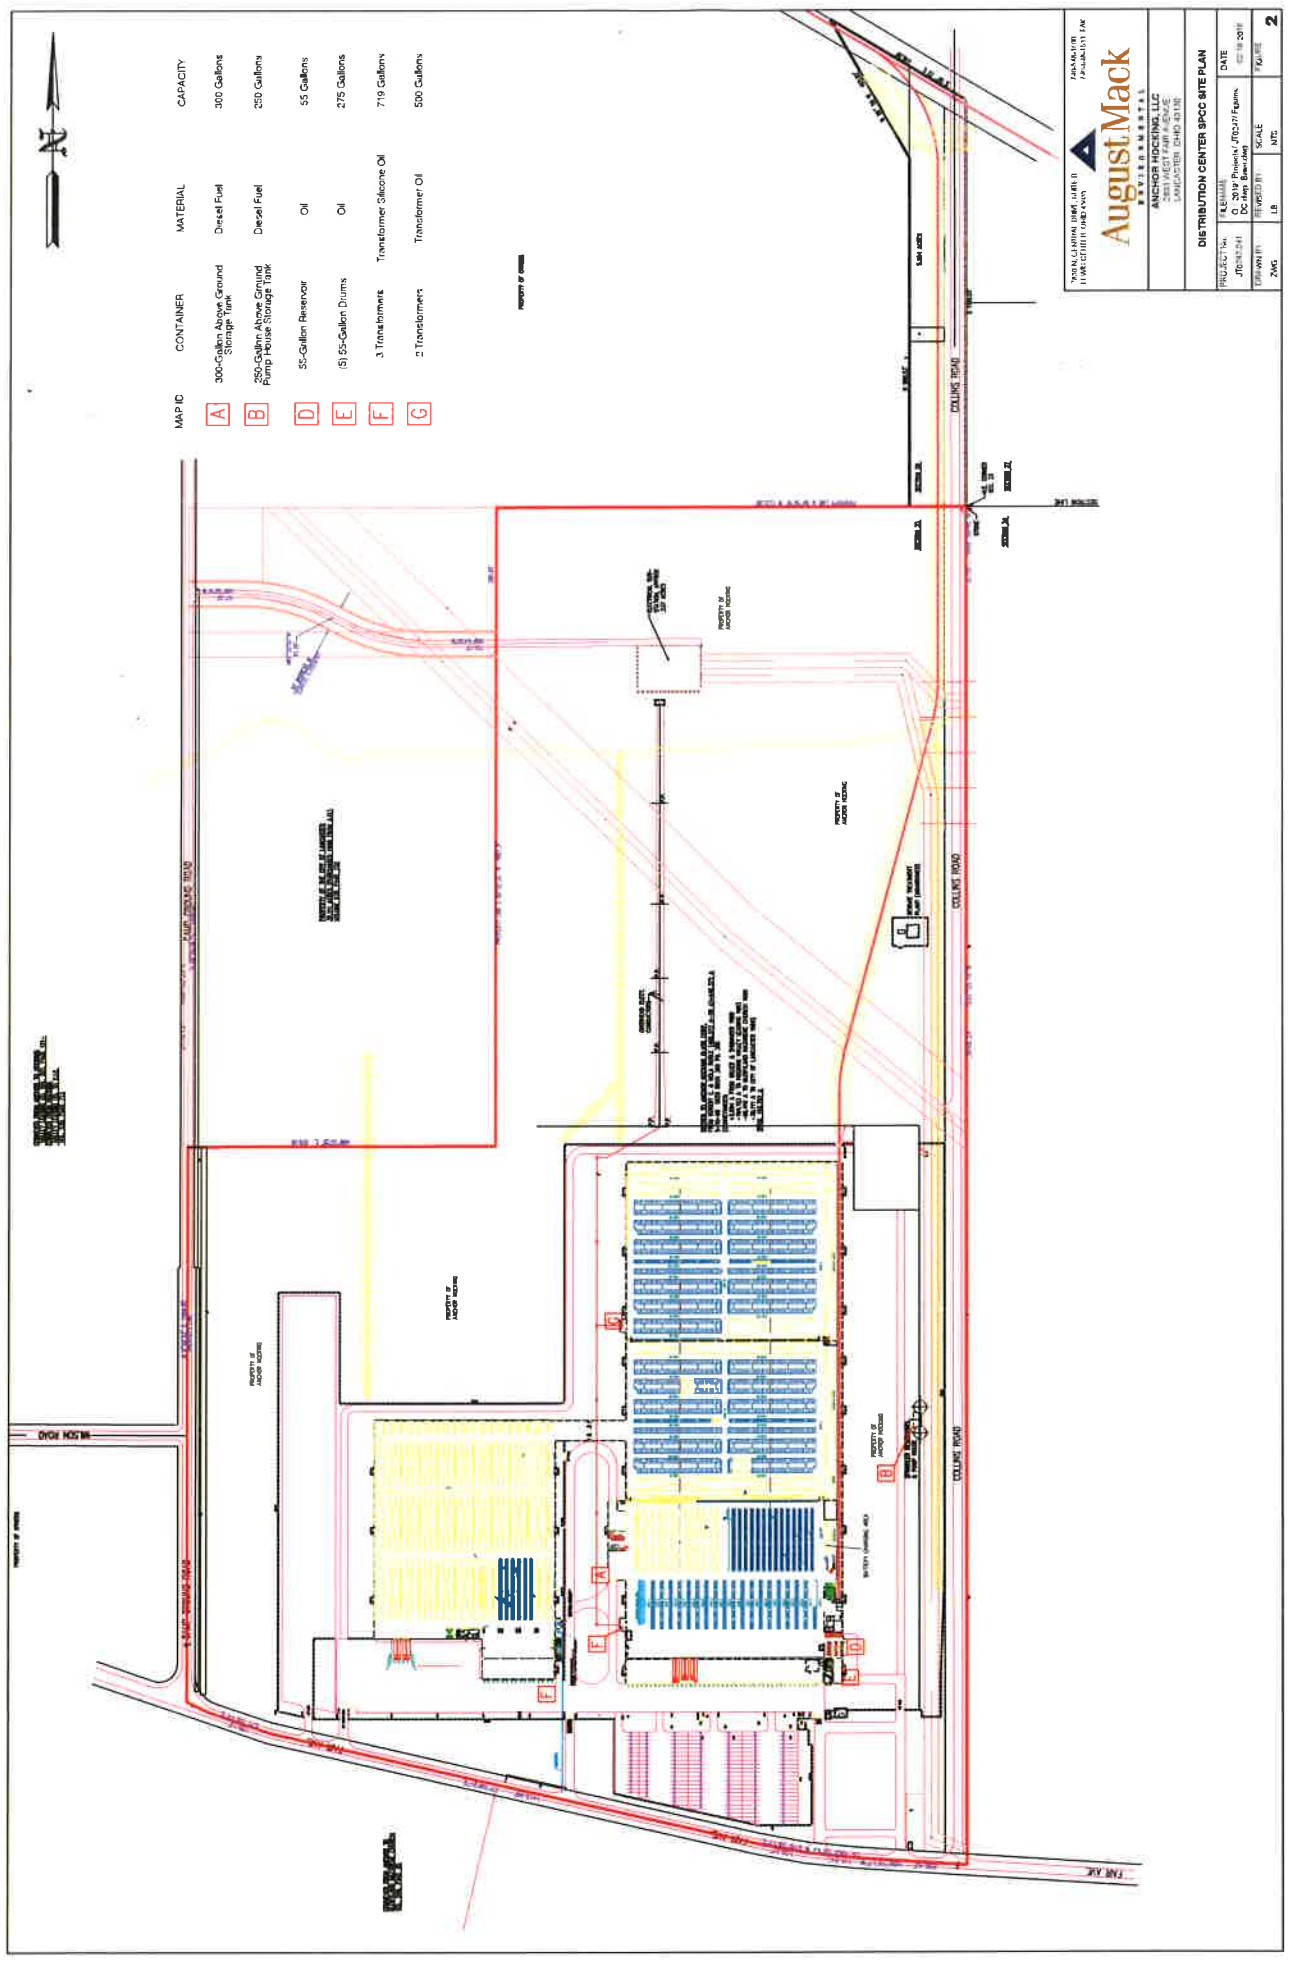

7000 W. BIRDA DRIVE, SUITE 10  
 HUNTSVILLE, AL 35894  
**August Mack**  
 CONSULTING ENGINEERS & ARCHITECTS  
 ANCHOR HOLDINGS, LLC  
 2801 WEST FAIRMOUNT AVE  
 LAWRENCE, MO 64501

PROJECT No.	SCALE	DATE
2018-01-01	AS SHOWN	08/18/2018
DESIGNED BY	REVIEWED BY	SCALE
ZMG	LB	N/A

**DISTRIBUTION CENTER SPCC SITE PLAN**

FIGURE	DATE
2	08/18/2018